
Photo Checklist for Battery Installation

Gateway wiring (and other wiring job photos in general)

*Should be taken for both Tesla and Enphase battery jobs.

Tesla



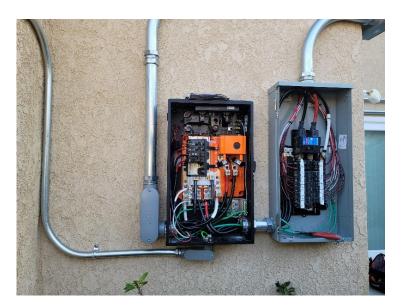

Enphase



Back up Gateway serial number (high-quality photo with clearly visible numbers)


*Should be taken for both Tesla and Enphase battery jobs.

Tesla





Enphase

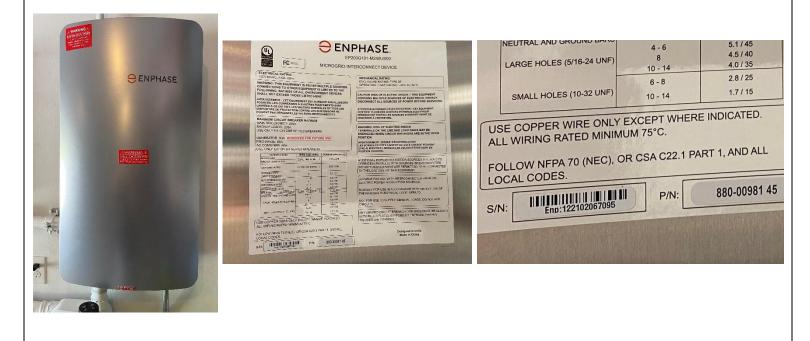


Battery serial number (high-quality photo with clearly visible numbers)

*Should be taken for both Tesla and Enphase battery jobs.

Tesla





Enphase








RISQUE DE CHOC ÉLECTRIQUE. LA

Main panel, Subpanel and Disconnect wiring photos

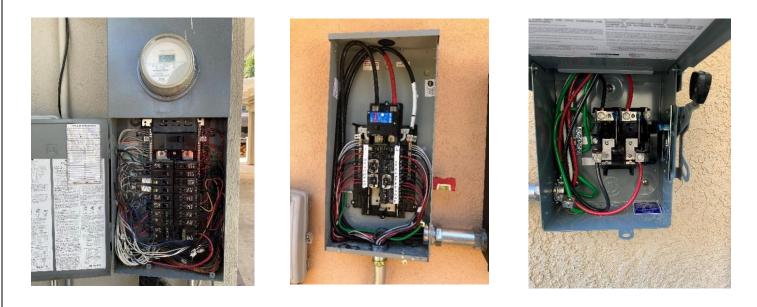

Main panel labeling, Main panel breaker and/or Subpanel breaker labeling, Downsized Main breaker, PV meter



Main panel / Equipment with 3'x3' clear level work space










Commissioning / Monitoring

*Should be taken for both Tesla and Enphase battery jobs.

		Commerciant in Drawn Darit more pour device away from Drawy
Home Energy Gate	eway	
2.6 kW		Gid connectivity
o kw 🧼	1.6 kW	
		6.2**
-1.1 kW		Producing
TESLA	, 21%	
	21% 50 ON GRID	@ - O
		Green
STOP SYSTEM System	SO ON GRID	Grand Barry Schwarter
Stop System	SO ON GRID	Brie Schwarten
STOP SYSTEM System	50 DN 6HI0 >	Greenwood
Stop System	50 DN 6HI0 >	0.2**

Ground rods, UFER

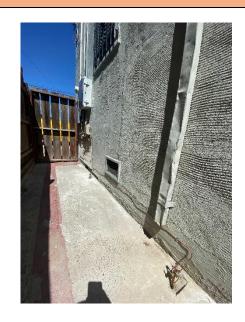











Other photos if such job has been done:

- Main water bonding with jumper at regulator
- Water heater bonding